
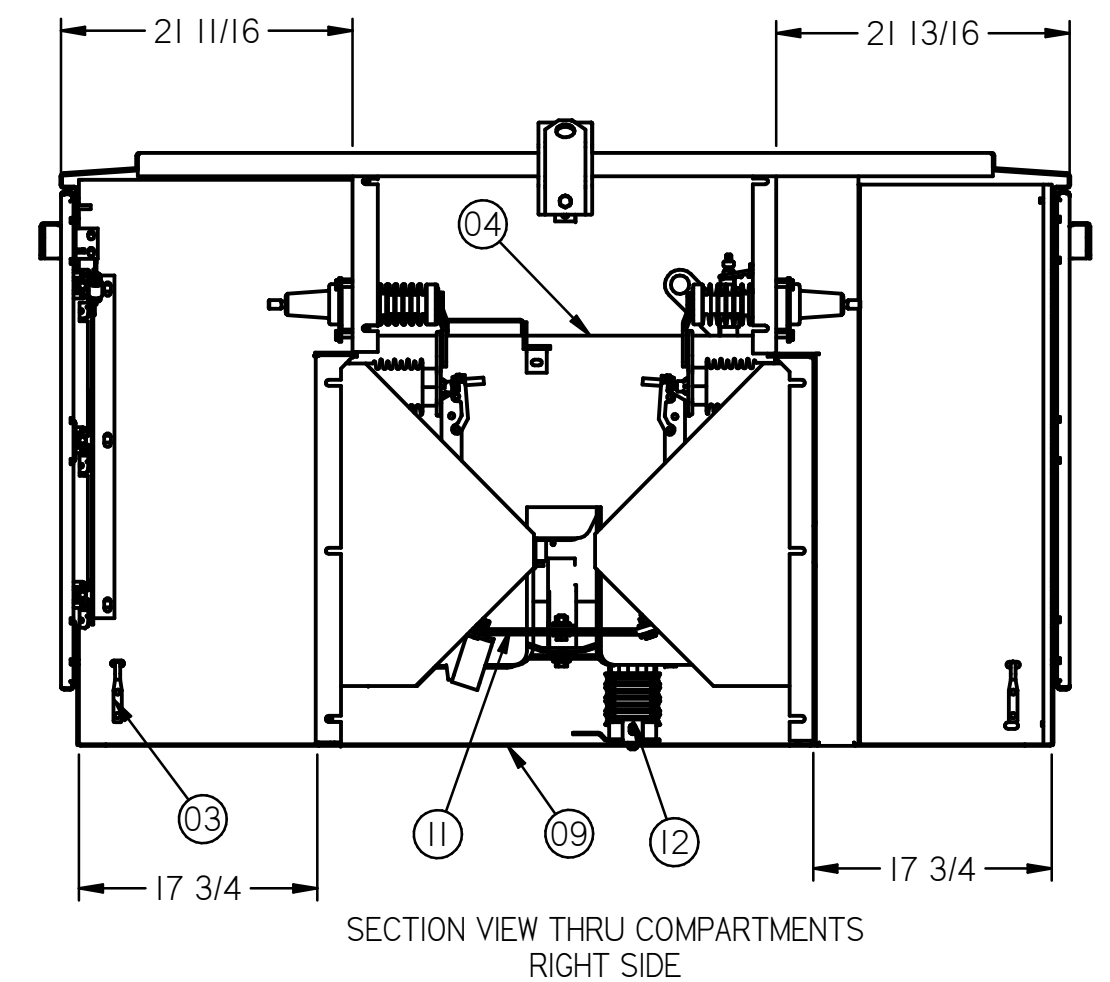


1. 11 GA MILD STEEL ENCLOSURE WITH FINISH COAT MUSELL NO. 7GY 3.29/1.5 GREEN.
2. REMOVABLE LIFTING BRACKETS.
3. NEMA 2 HOLE STAINLESS STEEL GROUND PADS WITH FULL WIDTH 3/8" DIA. COPPER GROUND BAR .
4. NEMA GRADE GPO-3 BARRIER, SWITCH AND FUSE.
5. OPERATING HANDLE AND SWITCH POSITION INDICATOR.
6. INSTRUCTION POCKETS PROVIDED.
7. NAMEPLATE AND 3-LINE DIAGRAM PROVIDED.
8. SWITCH AND FUSE VIEWING WINDOW.
9. GALVANIZED 16 GA STEEL FLOOR PAN WITH DRAIN SCREENS.
10. WARNING SIGNS AND LABELS.
11. 600 AMP ALUMINUM BUS BAR .
12. EPOXY INSULATORS.
13. CABLE GUIDES.
14. ACTIVE DOOR HAS 3 POINT LATCHING, CONCEALED STAINLESS STEEL HINGES AND PINS, PROVISIONS FOR PADLOCKING AND PENTA-HEAD SECURITY BOLTS AND 105° DOOR STOPS.
15. CROSS BROKEN ONE PIECE ROOF WITH ANTI-CONDENSATE APPLIED TO UNDERSIDE TO REDUCE MOISTURE BUILD-UP.
16. PROTECTIVE GASKET FOR BASE OF ENCLOSURE IS 1/2 X 1-1/2 CLOSED CELL FOAM TYPE.
17. PHASE INDICATION LABELS PROVIDED.
18. APPROXIMATE WEIGHT : 2500 LBS.

SWITCHGEAR PER ANSI/IEEE C37.72
BUSHINGS PER ANSI/IEEE 386
ENCLOSURE PER ANSI/IEEE C57.12.28

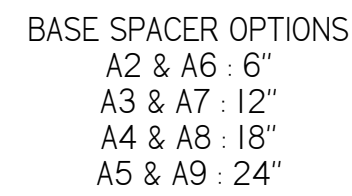

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF ELECTRO MECHANICAL CORP. OR ITS OPERATING DIVISIONS IN WHOM TITLE REMAINS. ANY REPRODUCTION, DISTRIBUTION, DISCLOSURE OR USE NOT OTHERWISE EXPRESSLY APPROVED IN WRITING IS STRICTLY PROHIBITED.

DATE	SYM.	REVISION RECORD	AUTH.	DR.	CK.