


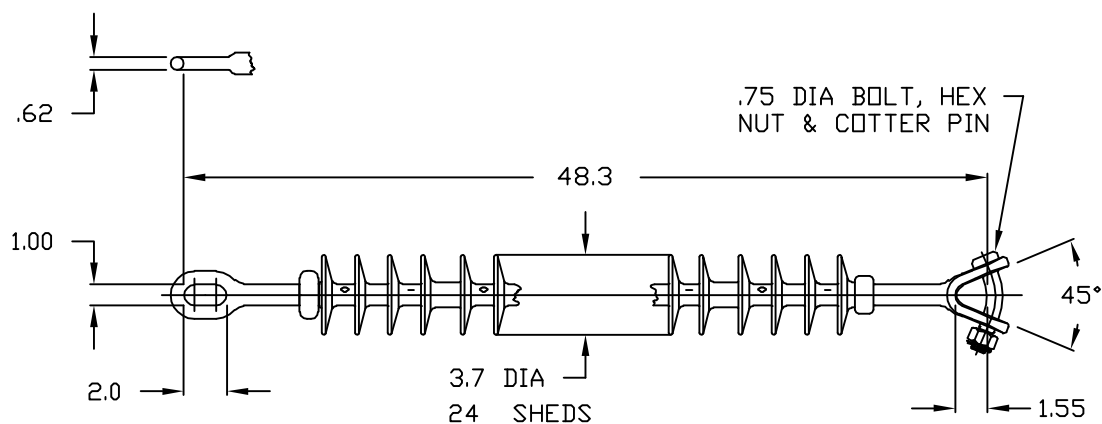

SPECIFIED MECHANICAL LOAD _____ 25000 POUNDS
 ROUTINE TEST LOAD RATING _____ 12500 POUNDS
 DRY ARCING DISTANCE _____ 36.8 IN
 LEAKAGE DISTANCE _____ 91 IN
 60 Hz DRY FLASHOVER _____ 370 kV
 60 Hz WET FLASHOVER _____ 350 kV
 POSITIVE IMPULSE CRITICAL FLASHOVER _____ 605 kV
 NEGATIVE IMPULSE CRITICAL FLASHOVER _____ 595 kV
 WEIGHT _____ 6.3 LB

HUBBELL/THE OHIO BRASS CO.

8711 WADSWORTH ROAD, WADSWORTH, OHIO

PART H*~~L~~ SUSPENSION INS

NAME 511006-1200

SCALE

.12=1

DESIGN RAB

DATE 10/04/96

DWG.
NO.

S012777-00

REV.
NO.

01

DRAWN JVR

DATE 11/11/97

Approved 11-24-1997