

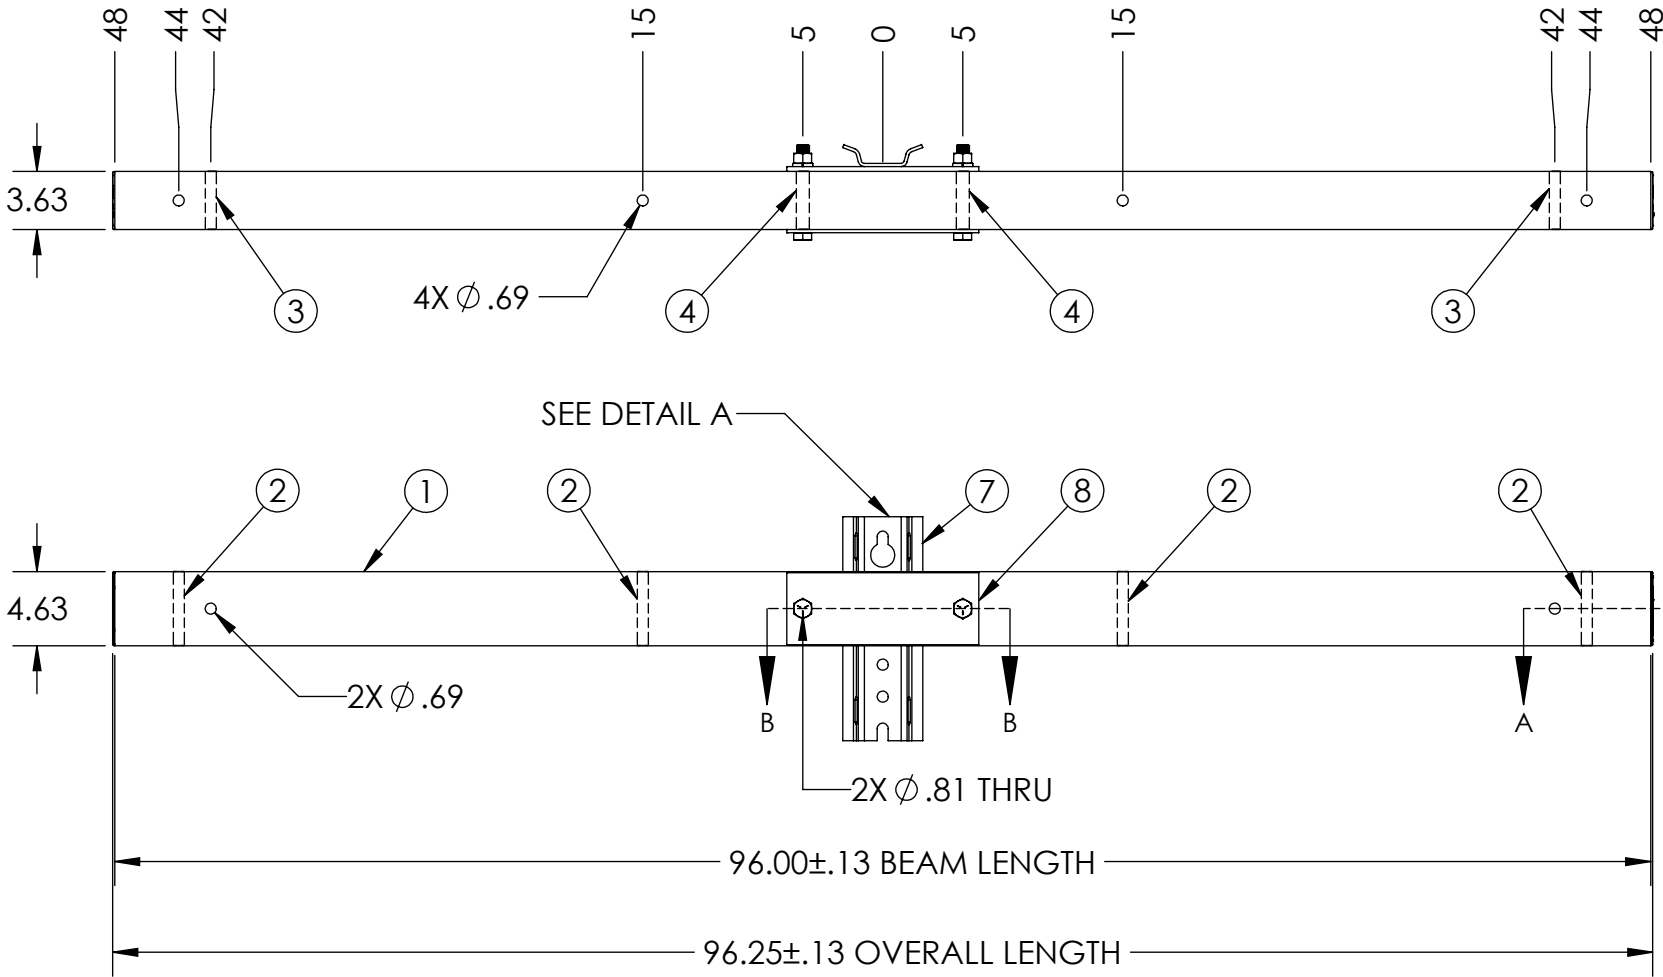
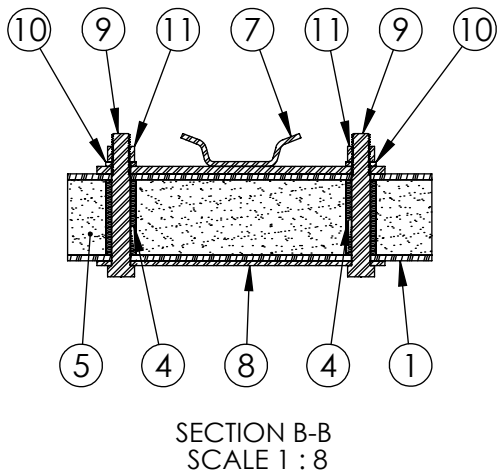



ITEM NO.	PART NUMBER	DESCRIPTION	DESCRIPTION 2	QTY
1	FB-096-2000-2	BEAM, PULTRUDED STOCK	SERIES 2000 x 96 in, GRAY	1
2	TG0688-0003	BUSHING	11/16 in x 4-1/16 in	4
3	TG0688-0004	BUSHING	11/16 in x 3-1/8 in	2
4	TG0813-0006	BUSHING	13/16 in x 3-1/8 in	2
5	FOAM	-	-	1
6	EC20-0001-2	END CAP	SERIES 2000, GRAY	2
7	TM-0044	MOUNT ASSEMBLY, TANGENT	SD	1
8	PL-0037	PLATE, FRONT		1
9	HB0750-0001	HEX BOLT	3/4 in - 10 x 5-1/2 in	2
10	LW0750-0001	LOCK WASHER	3/4 in	2
11	HN0750-0001	HEX NUT	3/4 in - 10	2

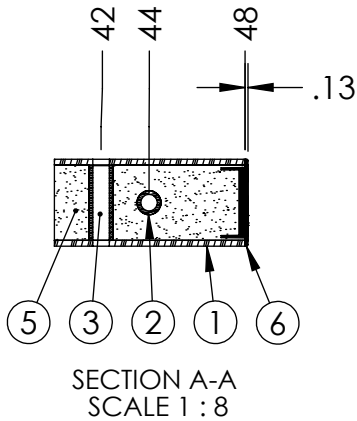

REVISIONS				
ECO	REV.	DESCRIPTION	DATE	INITIALS
	1.1	REDRAWN IN SOLIDWORKS	2013-02-06	RAF
1367	1.2	UPDATE DRAWING FORMAT	2016-01-21	RAF
3014	1.3	ADD LAOD RATINGS	2017-03-23	RAF

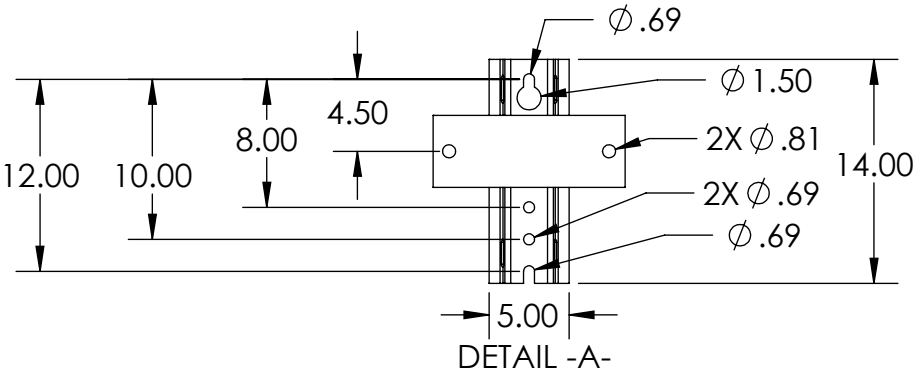

- NOTES:
- CENTER OF MOUNT HOLE(S) TO HOLES TOLERANCE ± 0.06
 - CALCULATED AVERAGE ULTIMATE VERTICAL LOAD = 6,750 LBS PER WIRE, 2 WIRES AT ± 44
= 3,500 LBS PER WIRE, 4 WIRES AT ± 15 & ± 44
 - CALCULATED AVERAGE ULTIMATE LONGITUDINAL LOAD = 5,250 LBS PER WIRE, 2 WIRES AT ± 44
= 2,750 LBS PER WIRE, 4 WIRES AT ± 15 & ± 44
 - CALCULATED AVERAGE ULTIMATE TRANSVERSE LOAD = 8,000 LBS PER SIDE
 - RECOMMENDED MAXIMUM WORKING LOAD OF 50% OF AVERAGE ULTIMATE STRENGTH

---UNLESS OTHERWISE SPECIFIED--- DIMENSIONS ARE IN INCHES INTERPRET DIM AND TOL PER ASME Y14.5-2009 ANGULAR: MACH±2° BEND ±2° ONE PLACE DECIMAL ±0.1 TWO PLACE DECIMAL ±0.02	STATE:	RELEASED	2017-03-28
	DRAWN:	RAF	2013-02-05
	CHECKED:	TRB	2017-03-28
	APPROVED:	TRB	2017-03-28
	REPLACES: TB2000-96-03X		
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF GEOTEK. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF GEOTEK IS PROHIBITED.	THIRD ANGLE PROJECTION		
			
CUSTOMER SIGNATURE:	DATE:		

1421 SECOND AVE NW
STEWARTVILLE, MN 55976
(800) 533-1680
www.geotekinc.com

DESCRIPTION:
TANGENT ASSEMBLY, SERIES 2000
96 in, RUS 03

SIZE: DWG. NO. **B TB200009603X2**

SCALE: 1:12 | WEIGHT: 41 LBS

BEAM COLOR: **GRAY**

REV: **1.3**

SHEET 1 OF 1